


120 VAC \* DISCRETE INPUT  
FROM CENTRIFUGE FEED PUMP  
N.O. CONTACT WITH PUMP  
RUNNING, BY OTHERS

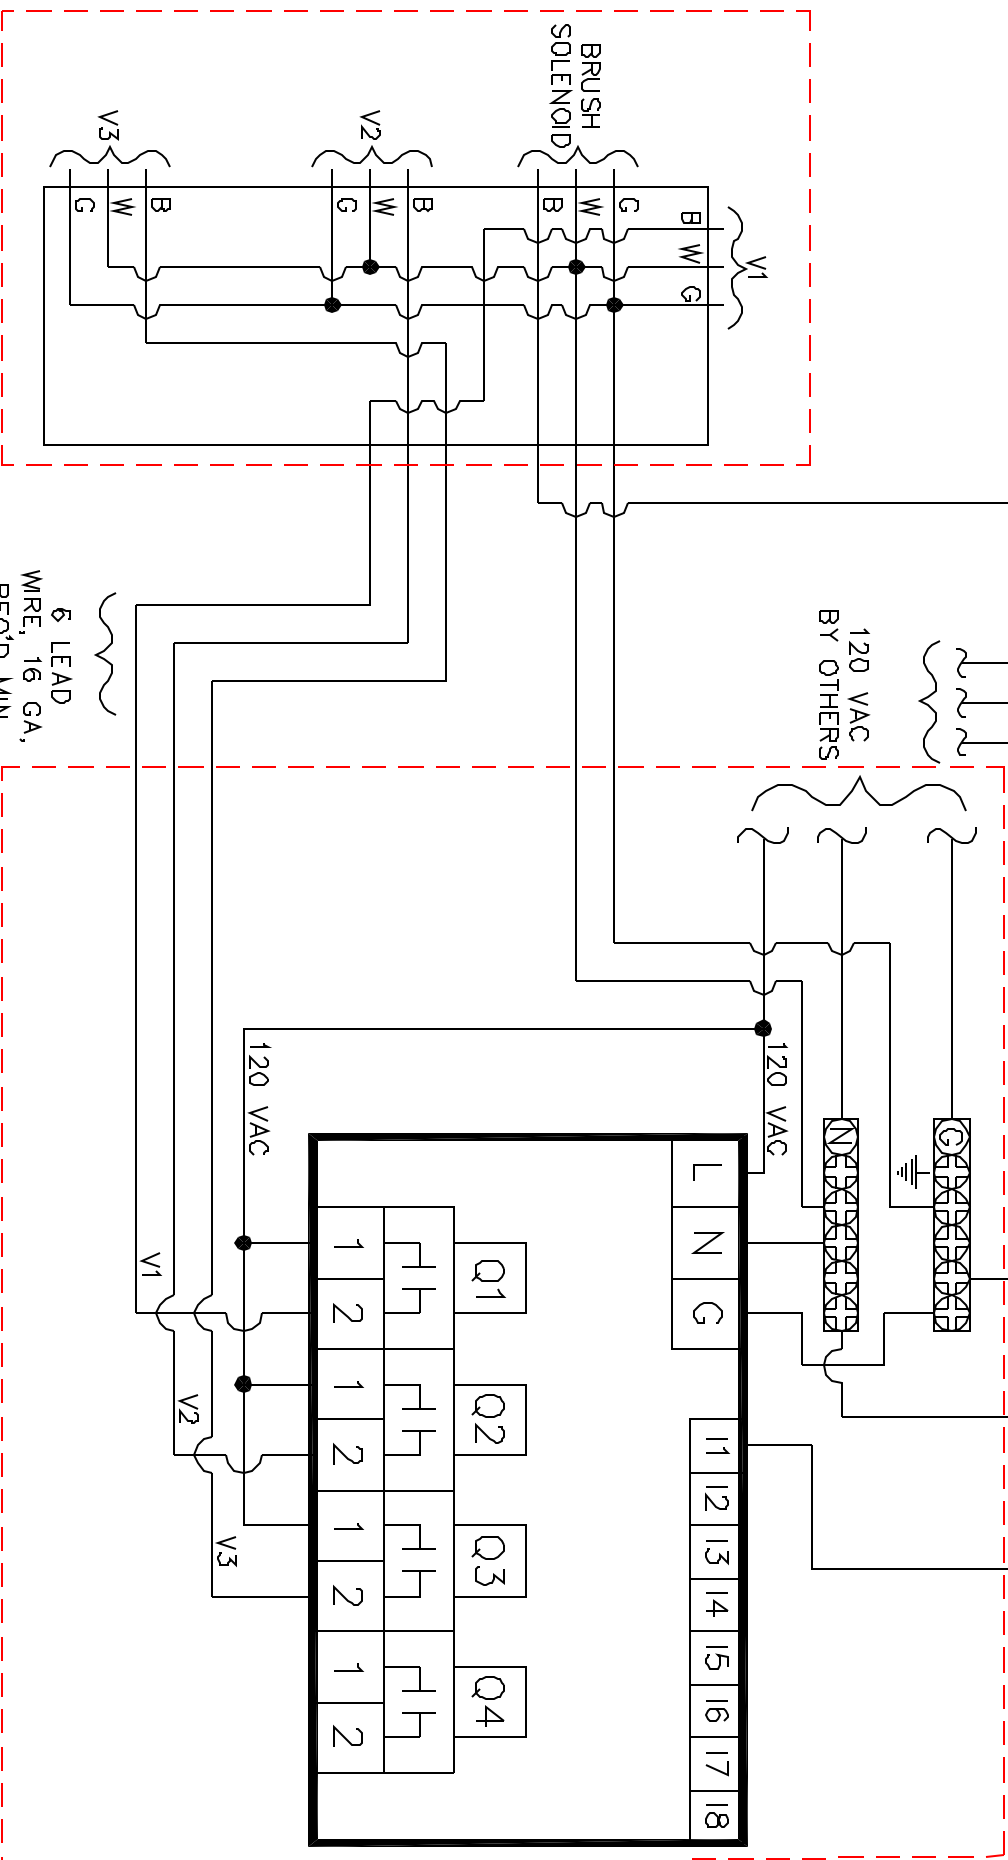

6 LEAD  
WIRE, 16 GA,  
REQ'D MIN.  
SUPPLIED BY  
CONTRACTOR IN FIELD

PLC BOX - DWG 132

\* - PUMP POWER MUST BE SAME  
PHASE AS POWER TO PLC & BB2.



Cerlic Environmental Controls, Inc.  
P.O. Box 420097  
Atlanta, GA 30342  
Phone (404) 256-3097  
Fax (404) 256-3094

WIRING DIAGRAM  
CENTRATE PLC TO  
VALVE JUNCTION BOX

DRAWING NUMBER  
137

PROJECT NUMBER  
NTS

NO.	DATE	BY	REVISION
1		JR	ISSUED FOR VALVE WIRING
2			
3			
4			
5			
6			
7			